

DGOZ-SEN-PRLLSW-IP
RAPIX DALI-2 IP Rated Long Range Occupancy Sensor
With Auxiliary Input

Suitable for direct connection to a DALI line for sensing, switching, dimming, timing, group and scene control and similar functions.

Product summary and capabilities

This product acts as an occupancy (presence) sensor, light level sensor, and push button switch input device, powered directly from the DALI line.

The sensor works with DALI-2 Application Controllers and exposes 3 instances. The sensor can also act as a RAPIX DALI Application Controller and can perform sensing, switching, dimming, timing, group control, scene control and similar functions. The sensor may have a separate voltage free switch connected, allowing additional push button control.

The sensor is commissioned using any DALI-2 commissioning software that supports instance types 1, 3 and 4. For the higher resilience of RAPIX and to set up the built-in Application Controller, use *RAPIX Addressing* or *RAPIX Integrator* software. These software packages are available at no charge from ozuno.com

This sensor is mounted in a sealed enclosure and has IP65 rating when suitable care is taken with mounting and electrical connection.



Important notes and safety information



WARNING – Electric shock may result in serious injury or death. Follow all warnings in this guide and on the product. Work in accordance with the latest electrical safety practices.

- This Sensor is powered only from DALI line.
- DALI system wiring is only single insulated from mains. Treat DALI wiring the same as mains wiring.
- The Auxiliary input wiring has no isolation from DALI. Treat the Auxiliary input the same as mains wiring.
- **The Auxiliary input does not provide any power source. Connect it only to voltage-free (dry) contacts or a switch. Do not connect any part of the Auxiliary Input to any other power source, or to earth, or to mains line or neutral.**
- There are **no user serviceable parts** inside the Sensor. Do not attempt to disassemble or operate the device with any covers removed.
- This sensor is intended for **indoor use only**.


Indicators



An indicator is located under the PIR lens. This will flash green when DALI-2 or RAPIX commissioning software activates the identification function. This allows physical location of the sensor after it has been installed.

This indicator will also light solid green (no flashing) to show that the sensor has not been commissioned using DALI-2 or RAPIX commissioning software or the RAPIX Zero-Commissioning processes.

Terminals

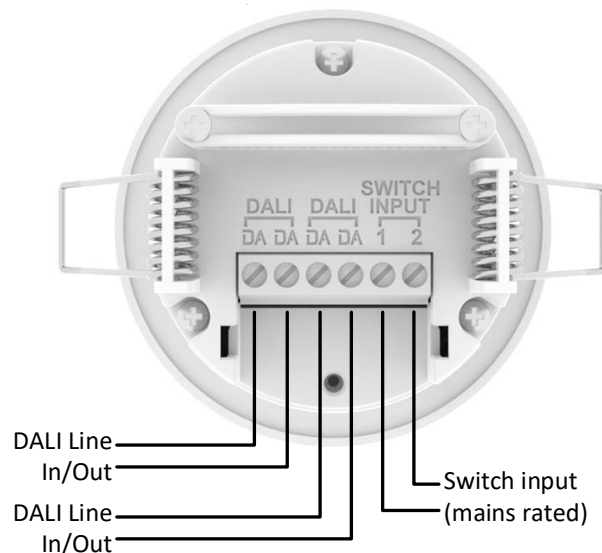

Mounting

The recommended mounting height is in the range 6 to 12 metres.

This sensor can be mounted to a bulkhead or on conduit.



WARNING – The IP rating of this sensor is only as good as the weakest part.

Any holes made in the enclosure will allow entry of water or moisture.

Take great care with mounting holes and cable entry. The guidance given here should help to prevent problems caused by entry of water into the product enclosure.

Use the following guidance:

1. **After being tightened: any screws used for mounting must be carefully sealed to prevent water entry around screw holes.**
Apply silicon sealer over and covering screw heads on the inside of the enclosure. Push sealer into place carefully so that no water entry is possible around screw holes and screw threads.
2. **Preferable: Connect the sensor to the electrical cabling system using conduit fittings with side entry into the back box.**
Conduit entry is preferred because it allows better sealing. Conduit fittings must be sealed where conduit enters bulkhead fittings, and around all sides of washers and under nuts, and so on. Apply silicon sealer before doing up nuts. Apply silicon sealer to conduit and into conduit fittings before mating conduit to fittings. Ensure all surfaces to be sealed are covered by sealer.
3. **If cable glands are used:**
 - a. **These must sit completely flush.** Carefully check the inside and outside surfaces. If needed, trim back internal plastic ribs from the enclosure body.
 - b. **Additional sealant must be used on all surfaces of all sealing washers (inside and outside) and on the inner nut.** Sealant should ooze out from all parts of washers when the inner nut is tightened.
 - c. **ONLY ROUND CABLE CAN PASS THROUGH A CABLE GLAND AND MAKE AN ADEQUATE SEAL.** Do not use mains oval-section TPS cable through a cable gland.
 - d. **All grommets and flexible parts of the cable sealing system in the cable gland must be in place and used.**
 - e. **Additional sealant around the cable passing through the gland is recommended.** This should ooze out when the cable nut is tightened.*Cable glands may allow a quick and easy connection, but they are very difficult to properly seal. Use the above guidance to help get good sealing. Preferably – use conduit connection instead.*
4. **After any installation using sealant, the sealant must be allowed to properly cure before final assembly.**
Silicon sealer can give off vapours while curing. A full curing should be allowed before final assembly so that vapours can dissipate. Different sealing compounds have different curing times so read the instructions for the compound being used. If in any doubt allow at least 24 hours curing time.

Commissioning Software

This product can be commissioned using any software that supports DALI-2 Control Devices (IEC 62386-103) Instance Types 1, 3 and 4.


For enhanced functions, additional resilience and to use the built-in Application Controller the free RAPIX Addressing or RAPIX Integrator software is available at ozuno.com. This software requires use of a RAPIX USB Interface or Zone Controller to connect the commissioning software / PC to the DALI line.

Use in non-RAPIX DALI-2 Systems

DALI standards require that this product is supplied with the built-in Application Controller enabled. The controller is commissioned using RAPIX software.

When used in non-RAPIX DALI-2 systems, use your commissioning software to **disable** the built-in Application Controller.

Typical Detection Range

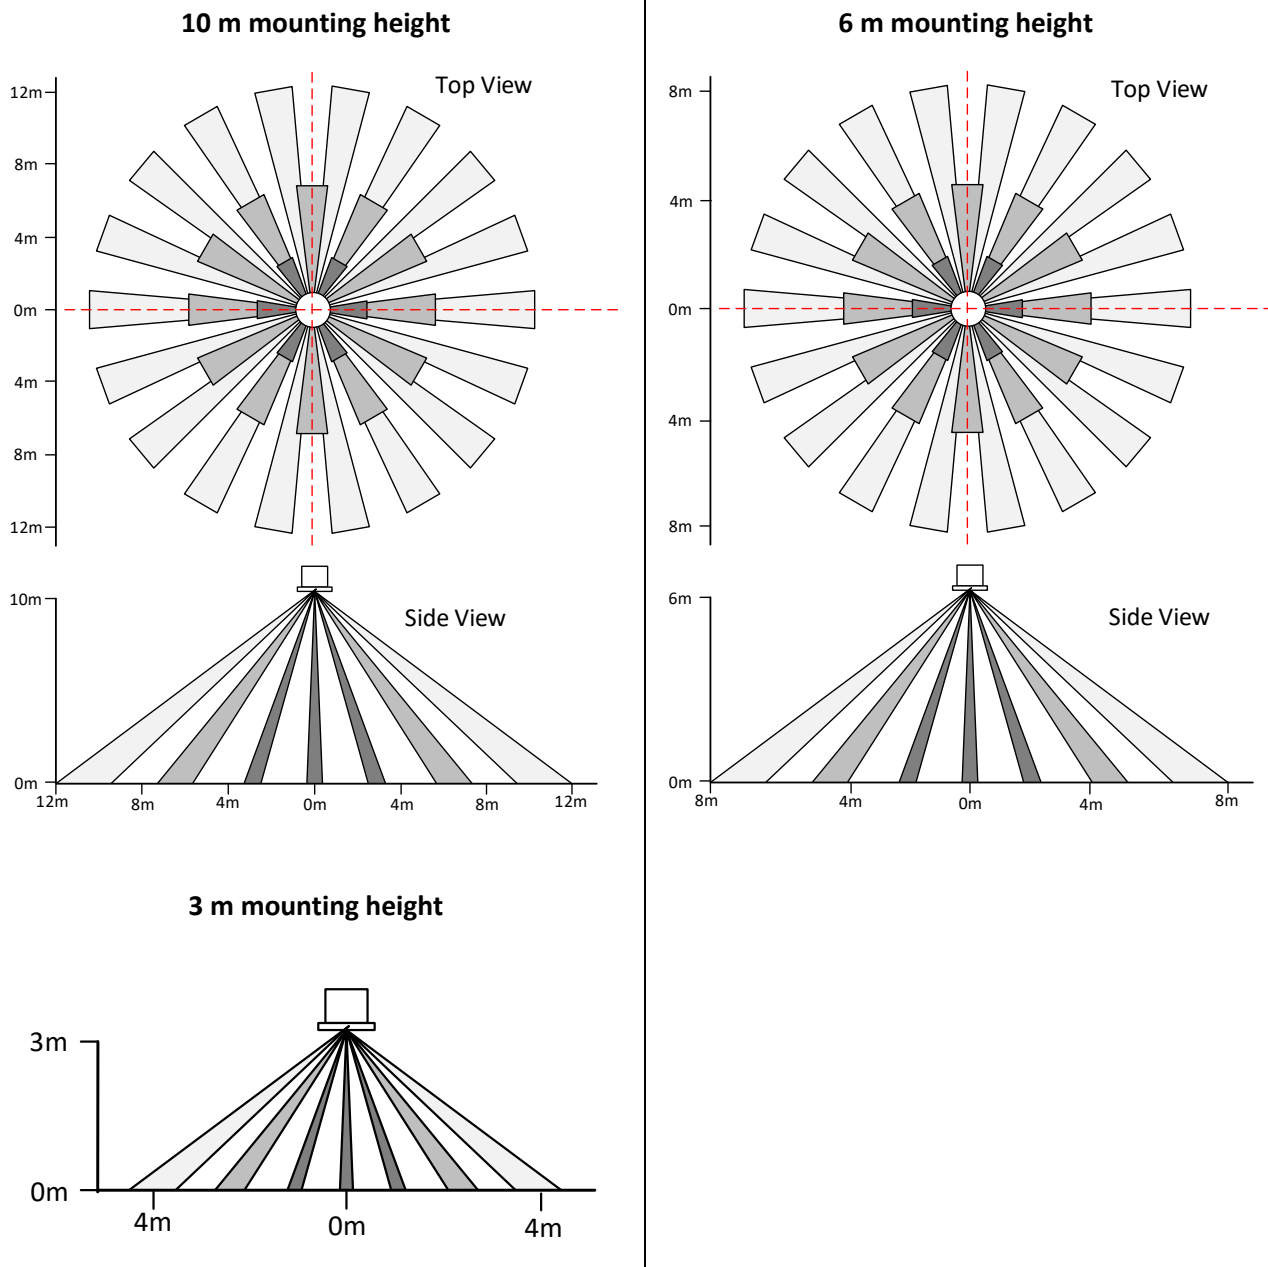

DALI-2 Instances

This sensor has 3 instances. Instance 0 is Type 4 Light Level. Instance 1 is Type 3 Occupancy Sensor. By default, Instance 2 is Type 1 Push Button. Instance 2 is always present. If no external switch is connected, then instance 2 will not generate events and will read as not pressed.

Auxiliary Input

By default, the auxiliary input is defined as a DALI-2 Push Button Switch (DALI-2 IEC 62386-301, Instance Type 1).

RAPIX Commissioning software uses a Template programming system, and this will automatically select an appropriate instance type for the desired function. This allows the auxiliary input to also be used for toggle type Bi-stable Switches, or the voltage-free contacts of an occupancy sensor.

Sensor Options

Sensor options can be activated by changing the DALI-2 Operating Mode, using the DALI command SET OPERATING MODE. When using RAPIX software, these options are selected by checkboxes during product commissioning. The following options are available by setting the Operating Mode:

Operating Mode	Optional Behaviour
0x00 (0)	Normal defaults: light level range 0 - 1023 lux. No blink under the lens for movement.
0x90 (144)	An indicator under the lens will blink when movement is detected.
0xC0 (192)	Light level high range: 0 – 65535 lux.
0xD0 (208)	Indicator under lens will blink on movement. Light level high range: 0 – 65535 lux.

RAPIX Zero-Commissioning: Out-of-box Functions

This sensor supports RAPIX Zero-Commissioning out of-box functions. All RAPIX Zero-Commissioning behaviour becomes automatically disabled when the sensor is given a DALI-2 Control Device Short Address, or when commissioned by RAPIX software.

RAPIX Zero-Commissioning behaviour for this product:

Switch input: By default this is **enabled**. A push button switch can be used on the switch input. This will:

- Transmit DALI BROADCAST FADE UP/DOWN when pushed and held.
- Transmit DALI BROADCAST ON/OFF for each push/release. When switching OFF, the motion sensor is disabled for 15 seconds to allow for an exit delay.

Motion Sensor: By default this is **disabled**. When enabled, movement will cause transmission of BROADCAST ON and start a 15-minute timer. Additional movement restarts the 15-minute timer. If the 15-minute timer expires a BROADCAST OFF will be transmitted. Multiple sensors can be used on the same DALI line.

To enable the Motion Sensor broadcast/timer function: WITHIN 15 MINUTES OF POWERING UP THE DALI LINE: Shine a very bright torch into and then away from the sensor lens 4 times until the green LED indicator goes out. The light must be shone in the lens for 2 seconds, then away from the lens for 2 seconds. The complete cycle of flashing light into the lens must be completed in under 30 seconds.

To disable the Motion Sensor broadcast/timer function: Cycle the DALI power OFF and ON 4 times. Each power cycle must have the DALI power on for no more than 10 seconds. When successfully disabled the green indicator behind the PIR Lens will be glowing. To check, wait for the power up blinking to stop.

To disable or enable the switch input: Press and hold the switch for 30 seconds continuously.

Standards and compliance

The product is designed to meet/exceed the following Australian and International standards:

EMC and Electrical Safety Frameworks and Standards

IEC/EN 55015, AS/NZS CISPR 15, AS CISPR 15
EN 55032, AS/NZS CISPR32
EN 55035
EN 61547
EN 61347-2-11, AS/NZS 61347.2.11
EN 61347-1, AS/NZS 61347.1
EN 62368-1







DALI Standards and Compliance


IEC 62386-101
IEC 62386-102

EC Council Directives

2014/35/EU Low Voltage
2014/30/EU Electromagnetic Compatibility (EMC)
2015/863 Restriction of Hazardous Substances (RoHS) in Electrical and Electronic Equipment

Specifications

Sensor	
Detection range (diameter)	Up to 24 metres, dependant on ceiling height. See diagrams for typical cases.
Suitable ceiling mounting heights	6 to 12 metres
Maximum mounting height	16 metres
Light Level Measurement Range	0 – 1023 lux (default). DALI Operating Mode allows optional high range: 0 – 65000 lux
Power Source	DALI line
Compatibility	DALI and DALI-2
DALI Line Capacity	Connects to 1 DALI line
DALI operating voltage	16 V dc (nominal), operation from 9.5 V – 22.5 V
DALI Line Current Draw	4 mA
Mains Tolerance	DALI input and auxiliary input are mains voltage tolerant
DALI Connection	4 Tunnel Terminal block Each tunnel suitable for 1 x 2.5 mm ² or 2 x 1.5 mm ² wires
Auxiliary Input Connection	2 Tunnel Terminal block Each tunnel suitable for 1 x 2.5 mm ² or 2 x 1.5 mm ² wires
Maximum Auxiliary Cable Length	25 m – when using twin core mains cable ≥ 0.75 mm ² wires
Auxiliary Input Types	DALI-2 Type 1 (Push button switch), Type 2 (Absolute / toggle switch) or Type 3 (voltage free contacts of an occupancy sensor). Changing instance type requires use of RAPIX Addressing or Integrator software.
Indicators	Identification: 1 x green, front through sensor lens
Ambient operating temperature	-30 to 50° C
Ambient storage temperature	-40 to 70° C
Humidity	0% to 95% RH non-condensing
Ingress protection	IP65, when suitable care is taken with mounting and cable entry.
Materials	Enclosure – UV stabilised, halogen-free, shock-proof PS
Weight	210 g
DALI addresses used	One DALI-2 Control Device Short Address, no Control Gear Short Addresses
DALI Addressing types supported	Short Addresses, Group Addresses, Scenes, Broadcast
RAPIX Application Controller DALI addressing types supported	Control Gear Short Addresses, Group Addresses, Scenes, Broadcast
Additional addressing types*	RAPIX Zones, RAPIX Flags, RAPIX Operating Properties
DALI addresses used	One DALI-2 Control Device Short Address, no Control Gear Short Addresses
Approvals	     
*	RAPIX features and additional addressing types work with other RAPIX products.

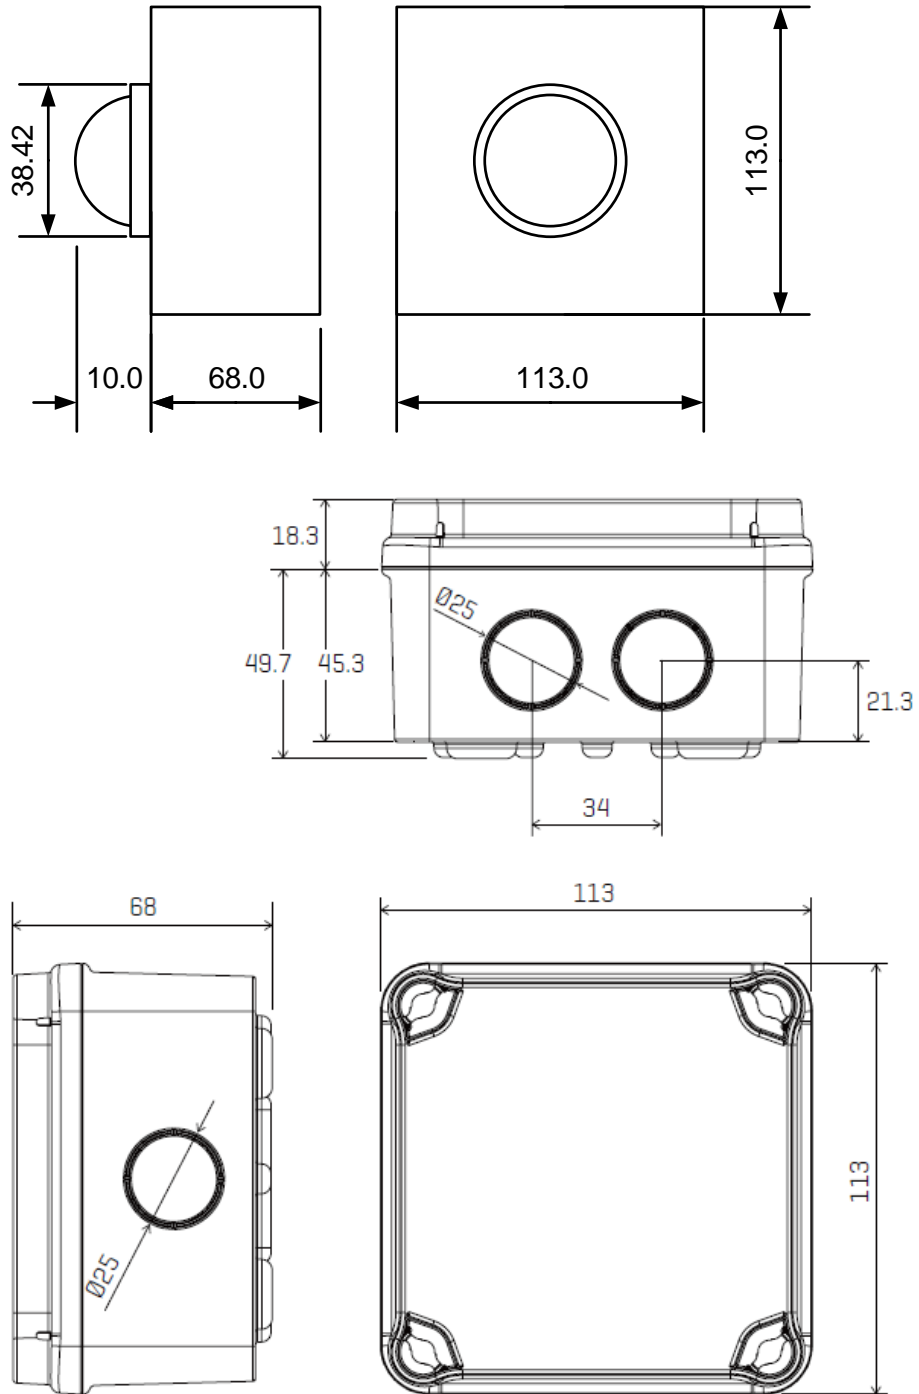Product dimensions

Warranty

This product has a TWO YEAR warranty against manufacturing defects. The warranty applies from the date of purchase.

The warranty does not cover product damage due to installation that allows entry of water into this sensor product.

Refer to [ozuno.com](https://www.ozuno.com) for the full conditions for warranty and returns process. A summary of the process:

1. Contact the seller of the goods, or in their absence contact Ozuno to request a return goods authorisation.
2. When a return is authorised, the goods must be returned to Ozuno at the owners expense for technical evaluation.
3. The warranty claim will be evaluated by Ozuno and accepted if the goods are found to be faulty, or rejected if the fault was caused by conditions beyond the responsibility of Ozuno. Considerations of installation, removal, return, freight and testing are not the responsibility of Ozuno.

The Australian Consumer Law requires the inclusion of the following statement with this Warranty:

Our goods come with guarantees that cannot be excluded under the Australian Consumer Law. You are entitled to a replacement or refund for a major failure and for compensation for any other reasonably foreseeable loss or damage. You are also entitled to have the goods repaired or replaced if the goods fail to be of acceptable quality and the failure does not amount to a major failure.

Ozuno Trading Pty Ltd (Ozuno) reserves the right to alter the specifications, designs or other features of any items and to discontinue any items at any time without notice and without liability. While every effort is made to ensure that all information in this user and installation guide is correct, no warranty of accuracy is given and Ozuno shall not be liable for any error.

Trademarks

RAPIX is a trademark of Ozuno Holdings Pty Ltd.

DALI and **DALI-2** are trademark of the Digital Illumination Interface Alliance.

Identified trademarks and copyrights are the property of Ozuno Holdings Pty Ltd unless otherwise noted.

© Copyright

This user and installation guide is copyright to Ozuno Holdings Pty Ltd. Except as permitted under relevant law, no part of this user and installation guide may be reproduced by any process without written permission and acknowledgement to Ozuno Holdings Pty Ltd.

Sales: Ozuno Trading Pty Ltd

ABN: 96 621 194 483

Support Contact

support@ozuno.com

